



Classified by
Underwriters Laboratories, Inc.
to UL 1479


System No. C-AJ-2337

F Rating — 3 Hr

T Rating — 0 Hr

W Rating - Class 1 (See Item 3B)

CAJ 2337

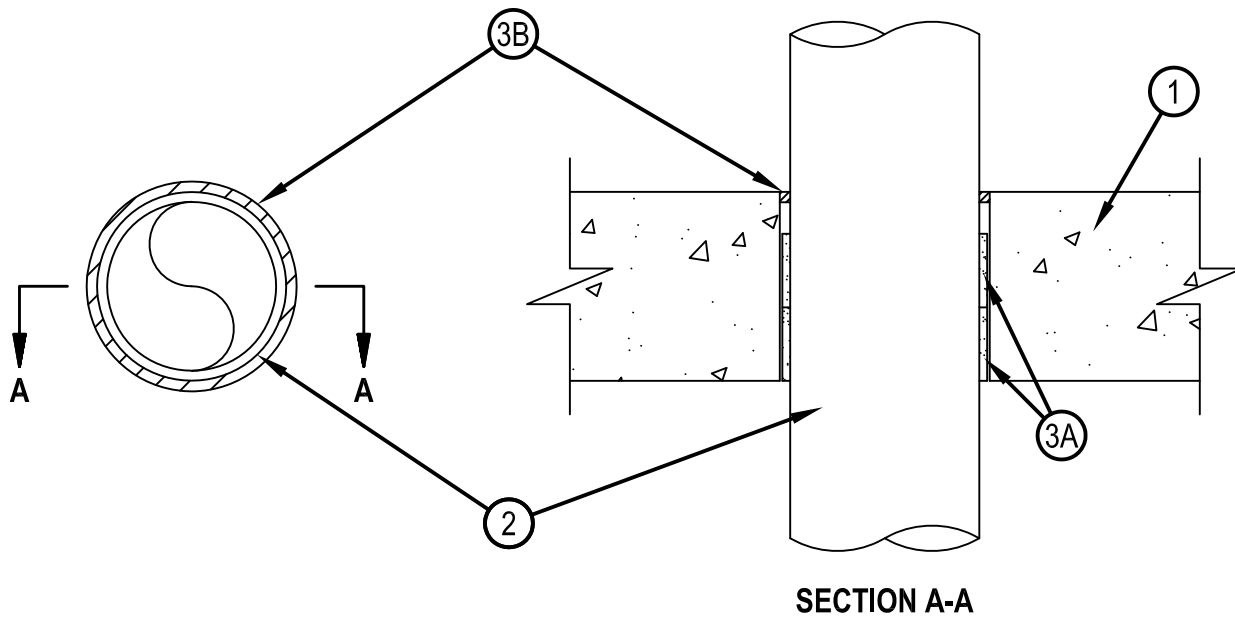

SECTION A-A

1. Floor or Wall Assembly — Min 4-1/2 in. (114 mm) thick reinforced lightweight or normal weight (100-150 pcf or 1600-2400 kg/m³) concrete or 5 in. (127 mm) thick reinforced lightweight or normal weight concrete wall. Wall may also be constructed of any UL Classified Concrete Blocks*. Max diameter of opening is 5 in. (127 mm).

See Concrete Blocks (CAZT) category in the Fire Resistance Directory for names of manufactures.

2. Through Penetrants — One nonmetallic pipe to be installed either concentrically or eccentrically within the firestop system. Annular space between pipe and edge of opening shall be min 3/16 in. (5 mm) to a max 5/16 in. (8 mm). Pipe to be rigidly supported on both sides of floor or wall assembly. The following types and sizes of nonmetallic pipes may be used:

A. Acrylonitrile Butadiene Styrene (ABS) Pipe — Nom 4 in. (102 mm) diam (or smaller) Schedule 40 solid or cellular core ABS pipe for use in closed (process or supply) or vented (drain, waste or vent) piping systems.

3. Firestop System — The firestop system shall consist of the following:

A. Fill Void or Cavity Material* - Wrap Strip — Nom 3/16 in. (5 mm) thick by 1-3/4 in. (44 mm) wide intumescent wrap strip. Two layers of wrap strips individually wrapped around pipe with ends butted and held in place with tape. In floors, wrap strip butted side to side and slid into annular space with the lower edge flush with bottom surface of floor. In walls, one wrap strip inserted into annular space from each side of wall, and recessed 1/4 in. (6 mm).

HILTI CONSTRUCTION CHEMICALS, DIV OF HILTI INC — "CP68-E W45/1-3/4" Wrap Strip

B. Fill Void or Cavity Materials* - Sealant — Min 1/4 in. (6 mm) thickness of fill material applied within the annulus, flush with top surface of floor or both surfaces of wall. W Rating applies only when CP 601S, CFS-S SIL GG or CFS-S SIL SL (floors only) Sealant is used.

HILTI CONSTRUCTION CHEMICALS, DIV OF HILTI INC — FS-ONE Sealant, FS-ONE MAX Intumescent Sealant, CFS-S SIL GG, CFS-S SIL SL (floors only) or CP 601S Sealant

* Indicates such products shall bear the UL or cUL Certification Mark for jurisdictions employing the UL or cUL Certification (such as Canada), respectively.



Hilti Firestop Systems

Reproduced by HILTI, Inc. Courtesy of
Underwriters Laboratories, Inc.

January 09, 2015